

# Cuyahoga County Animal Shelter

9500 Sweet Valley Drive  
Valley View, Ohio 44125

Fire Damper Inspection Report  
June 25, 2020

*Duct Fabricators, Inc.*  
**FIRE SAFETY DIVISION**



Report Date: July 17, 2020  
Project: Cuyahoga County Animal Shelter  
Inspector(s): Julie Gue, Certified Technician

Inspection and Test Date(s):

- June 25, 2020

Duct Fabricators, Inc. "Fire Safety Division" inspected the four (4) fire dampers for proper installation. The dampers were then tested and photographed in the "open" and "closed" positions to confirm that they were functioning as designed.

All dampers have passed the inspection and functional testing.

NOTES: NFPA 80, NFPA 101 and NFPA 105 require newly installed dampers to be inspected and tested one year after initial installation. Thereafter, dampers are to be visually inspected every two years and functionally tested every four years.

Additionally, the information contained herein verified whether the dampers were functional at the time of testing. This verification process does not represent any form of a guarantee that the dampers will properly perform in the future.

Duct Fabricators, Inc.  
 883 Addison Rd. Cleveland, Ohio  
 P: 216-391-2400 F:216-391-2492



Fire / Smoke / Fire & Smoke Damper  
Composite Inspection Report

	<u>FD/SD/FSD</u>	<u>I.D.#</u>	<u>Size</u>	<u>Manufacturer</u>	<u>Model</u>	<u>Visual</u>	<u>Functional</u>	<u>Comments</u>
1	FD	FD-1	8" Round	Ruskin	CFDR5	PASS	PASS	NONE
2	FD	FD-2	6" round	Ruskin	CFDR5	PASS	PASS	NONE
3	FD	FD-3	6" round	Ruskin	CFDR5	PASS	PASS	NONE
4	FD	FD-4	8" round	Ruskin	CFDR5	PASS	PASS	NONE
5								
6								
7								
8								
9								
10								
11								
12								
13								
14								
15								
16								
17								
18								
19								
20								

Inspector: Julie Gue  
Inspection Dates: 25-Jun-20  
Facility: Animal shelter

SA = Supply Air      FD = Fire Damper  
 RA = Return Air      SD = Smoke Damper  
 EA = Exhaust Air      FSD = Fire Smoke Damper

## CUYAHOGA COUNTY DAMPER INSPECTION REPORT

**Date of Inspection**

2020-06-25

**Facility Location**

County Animal Shelter

**Damper Location**

Corridor 059 between rooms  
03\04 supply diffuser

**Inspector Name**

Julie Gue

**Damper I.D. #**

Fire damper #1

**Damper Type**

Ceiling Radiation Damper

**Damper Size**

8" round

**Damper Manufacturer**

Ruskin

**Damper Model #**

CFDR5

**Fusible Link Temperature**

165 Degrees

**Access Door Size**

Supply diffuser

**Pass / Fail / Abandoned**

Pass

**Comments / Corrections**

None

**Picture of Damper in Open Position**



**Picture of Damper in Closed Position**



**Picture of Damper I.D. Label**



## CUYAHOGA COUNTY DAMPER INSPECTION REPORT

**Date of Inspection**

2020-06-25

**Facility Location**

County Animal Shelter

**Damper Location**

Corridor 059 between  
files(011)/med super(010)

**Inspector Name**

Julie Gue

**Damper I.D. #**

Fire damper #2

**Damper Type**

Ceiling Radiation Damper

**Damper Size**

6" round

**Damper Manufacturer**

Ruskin

**Damper Model #**

CFDR5

**Fusible Link Temperature**

165 Degrees

**Access Door Size**

Supply diffuser

**Pass / Fail / Abandoned**

Pass

**Comments / Corrections**

None


**Picture of Damper in Open Position**



**Picture of Damper in Closed Position**



**Picture of Damper I.D. Label**

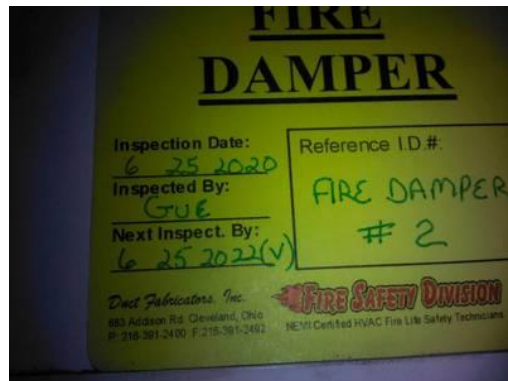

## CUYAHOGA COUNTY DAMPER INSPECTION REPORT

**Date of Inspection**

2020-06-25

**Facility Location**

County Animal Shelter

**Damper Location**

Files (011)

**Inspector Name**

Julie Gue

**Damper I.D. #**

Fire damper #3

**Damper Type**

Ceiling Radiation Damper

**Damper Size**

6" round

**Damper Manufacturer**

Ruskin

**Damper Model #**

CFDR5

**Fusible Link Temperature**

165 Degrees

**Access Door Size**

Supply diffuser

**Pass / Fail / Abandoned**

Pass

**Comments / Corrections**

None

**Picture of Damper in Open Position**



**Picture of Damper in Closed Position**



**Picture of Damper I.D. Label**



## CUYAHOGA COUNTY DAMPER INSPECTION REPORT

**Date of Inspection**

2020-06-25

**Facility Location**

County Animal Shelter

**Damper Location**

Corridor 059 outside of R.R (014)

**Inspector Name**

Julie Gue

**Damper I.D. #**

Fire damper #4

**Damper Type**

Ceiling Radiation Damper

**Damper Size**

8" round

**Damper Manufacturer**

Ruskin

**Damper Model #**

CFDR5

**Fusible Link Temperature**

165 Degrees

**Access Door Size**

Supply diffuser

**Pass / Fail / Abandoned**

Pass

**Comments / Corrections**

None

**Picture of Damper in Open Position**



**Picture of Damper in Closed Position**



**Picture of Damper I.D. Label**

