


Vent required if outlet exceeds 10 ft. developed length. Main or branch vent must be installed within 3 ft. of interceptor.

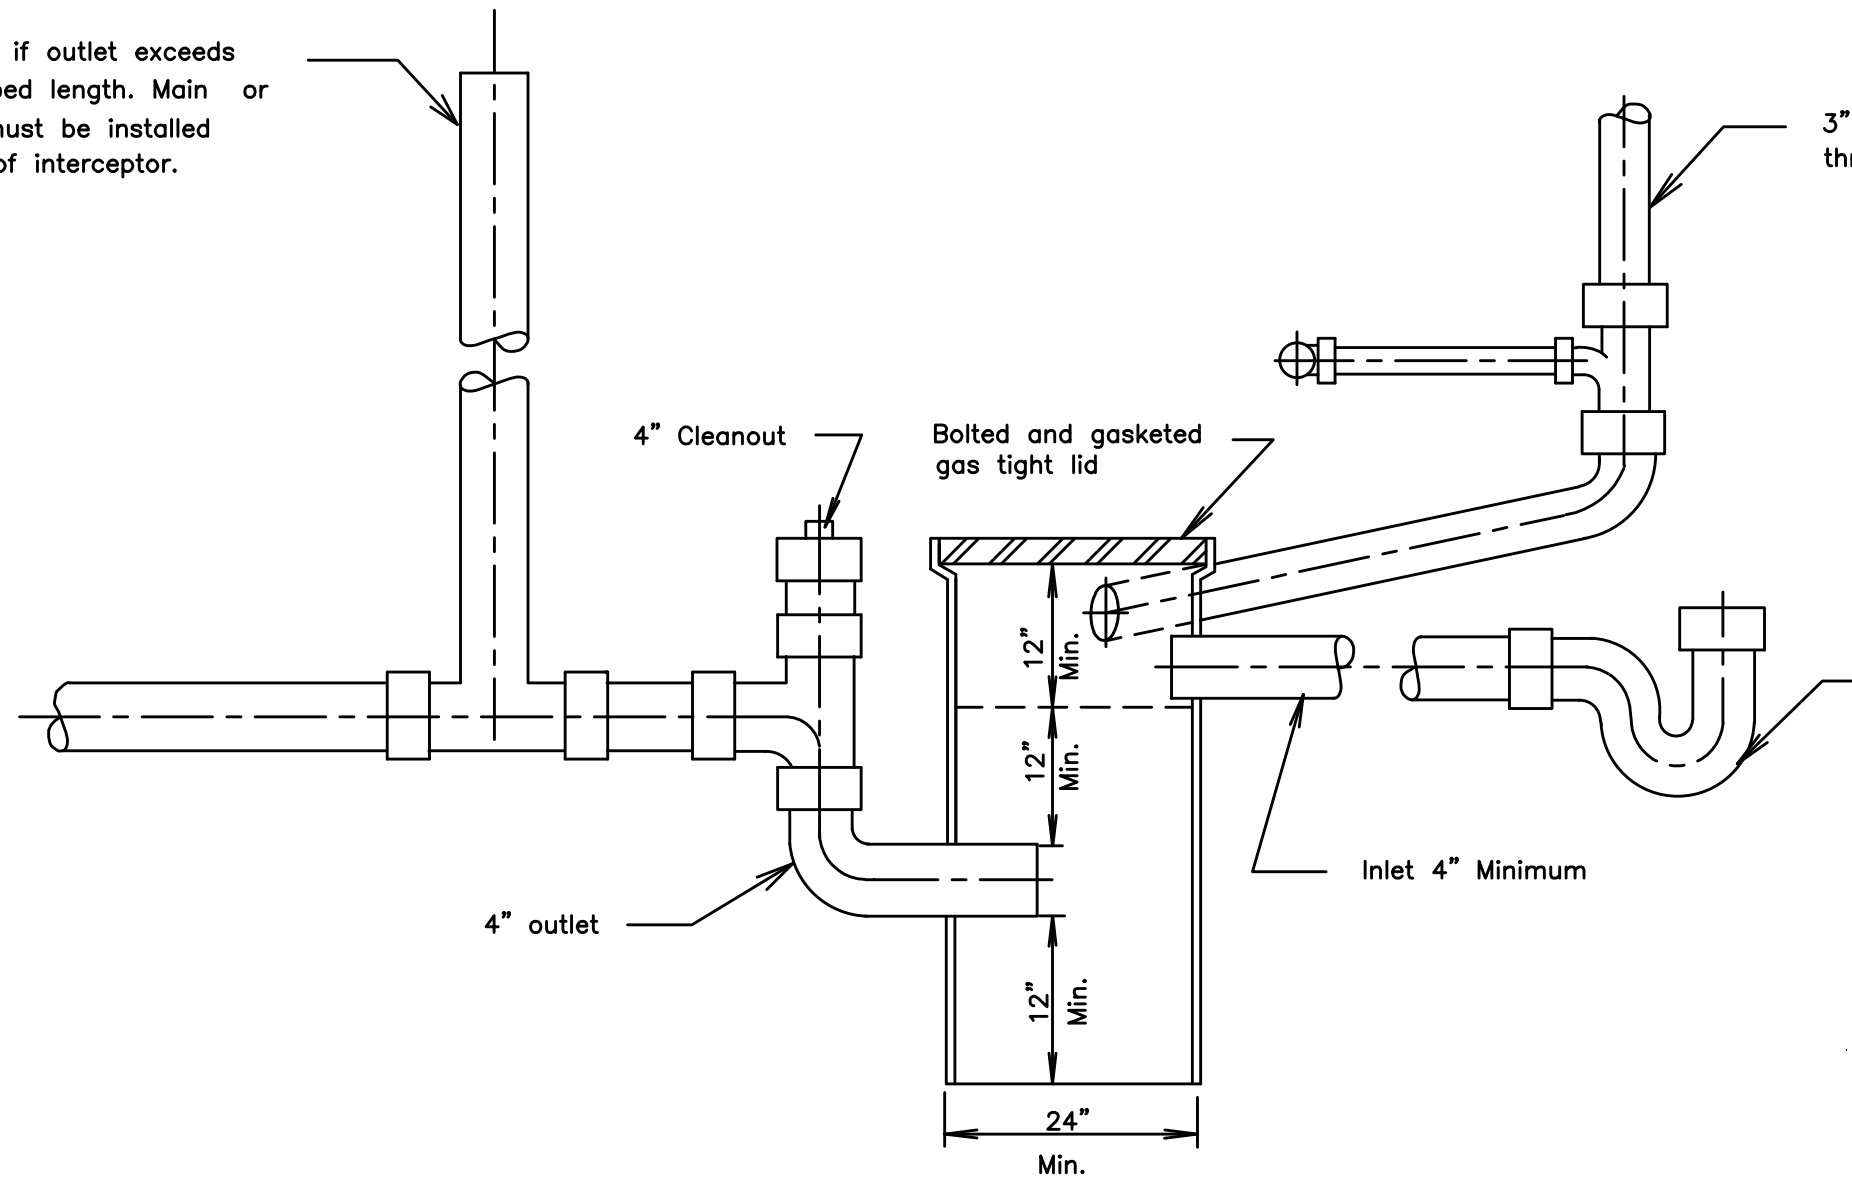

3" Min. local vent separately through the roof

if inlet pipe is over 25' - 0" in developed length, a vent is required, (industrial)
4101:2-51 - 24 (OAC)

NOTE:

For Minimum sizes refer to Plumbing code chapter 4101:2-51.

TYPICAL GARAGE OIL INTERCEPTOR

REVISIONS:

SCALE
NO SCALE

DATE : DEC. 1998

UNIFORM STANDARDS:

CLEVELAND --- CUYAHOGA COUNTY --- NORTHEAST OHIO REGIONAL SEWER DISTRICT